

ⓁⓁ Smoke detector linked to whole house system

ⓁⓁ Heat detector linked to whole house system

🔊 Sounder linked to whole house system

ⓁⓁ Control and indicator panel linked to whole house system


⦿ Emergency lighting

↗️ FD30S fire door with self closing device

— 30 minute fire resistance

DRAWING NO. 12
2 Storey.
Shared house HMO
Supported lodgings accommodation
January 2009

Not covered in LACORS guide

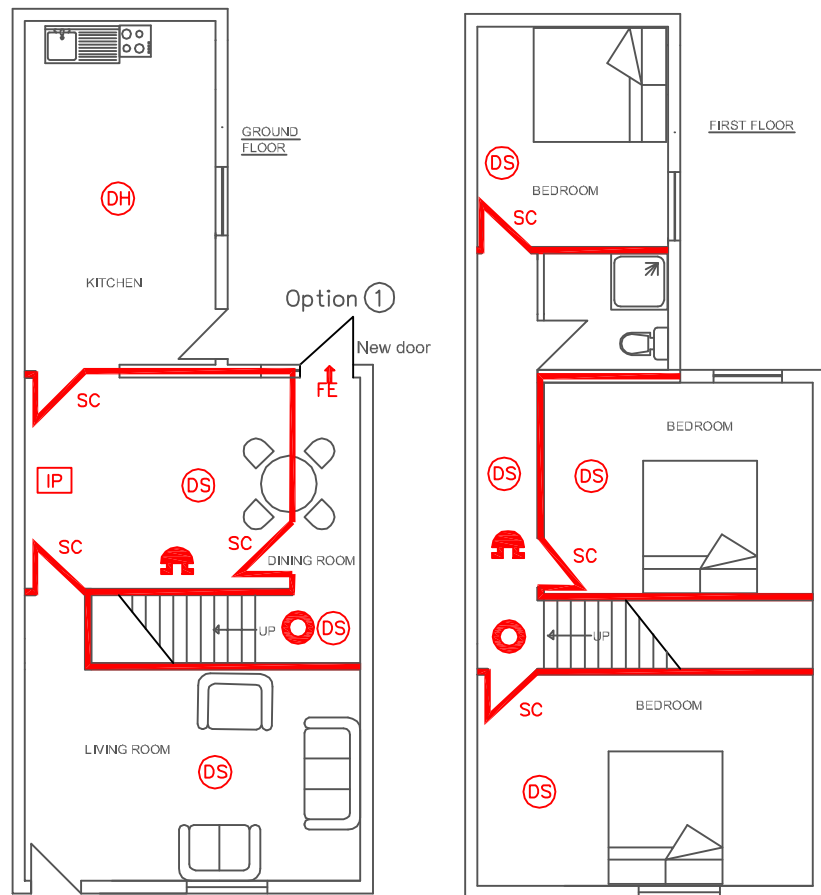

2 Options for means of escape

- ① Provide protected route to final exit (option shown as an example only)
- ② Provide residential sprinklers and accept sound traditional construction – with substantial solid doors